



2241 221st Ave. NE • East Bethel, MN 55011
Phone: (763) 367-7844 • Fax: (763) 434-9578

RESIDENTIAL DECK INFOREMATIION SHEETS

Building permits

Permits required for any deck attached to a structure or any detached deck more than 30 inches above grade.

Setback in Single-family (R-1) Residential District

1. Front yard (City right-of-way): Not less than 30 feet.
2. Front yard (County/State right-of-way): Not less than 100 feet.
3. Front yard (Shoreland overlay): 25 feet.
4. Side lot line: Not less than 10 feet.
5. Side street lot line (City right-of-way): Not less than 25 feet.
6. Side street lot line (County/State right-of-way): Not less than 100 feet.
7. Rear yard lot line: Not less than 25 feet.
8. No encroachment shall be permitted in existing or required drainage or utility easements.

Setback in Single-family (R-2) Residential District (In Whispering Aspen)

1. Front yard (City right-of-way): Not less than 28 feet.
2. Side lot line: Not less than 10 feet.
3. Side street lot line (City right-of-way): Not less than 25 feet.
4. Rear yard lot line: Not less than 20 feet.
5. No encroachment shall be permitted in existing or required drainage or utility easements.

Setback in Single-family (R-2) Residential District (Not in Whispering Aspen)

1. Front yard (City right-of-way): Not less than 30 feet.
2. Front yard (County/State right-of-way): Not less than 100 feet.
3. Front yard (Shoreland overlay): Not less than 25 feet.
4. Side lot line: Not less than 10 feet.
5. Side street lot line (City right-of-way): Not less than 25 feet.
6. Rear yard lot line: Not less than 25 feet.
7. No encroachment shall be permitted in existing or required drainage or utility easements.

Setback in Rural Residential (RR) District

1. Front yard (City right-of-way): Not less than 40 feet.
2. Front yard (County/State right-of-way): Not less than 100 feet.
3. Side lot line: Not less than 25 feet.
4. Side street lot line (City right-of-way): Not less than 40 feet.
5. Side street lot line (County/State right-of-way): Not less than 100 feet.
6. Rear yard lot line: Not less than 25 feet.
7. No encroachment shall be permitted in existing or required drainage or utility easements.

Frost footings

Required for any deck attached to a dwelling, porch or garage that has frost footings. The minimum depth to the base of the footing is 42 inches.

Live load

All decks shall be designed to support a live load of 40 pounds per square foot.

Guards/guardrails

All decks or stairs more than 30 inches above grade require guards. *See page four for illustration.* **Exception:** On an open stairway, the triangular opening formed by the riser, tread and bottom element of a guardrail must be sized so that a six inch sphere cannot pass through.

Cantilevers: Overhanging joists and beams

Joists should not overhang beams by more than two (2) feet, nor should beams overhang posts by more than one (1) foot unless a special design is approved. Joist shall not overhang a beam by more than one (1) foot if a roof is to be proposed. Beams shall not overhang posts if a roof is proposed.

Framing details

Headers, beams and joists that frame into ledgers boards or beams shall be supported by approved framing anchors such as joist hangers. Beams may be required to have direct support down to footings

Flashing

All connections between deck and dwelling shall be weatherproof. Cuts in exterior finish shall be flashed.

Nails and screws

Use only stainless steel, high strength aluminum or hot dipped galvanized.

Wood required

All exposed wood is required to be approved wood with natural resistance to decay (redwood, cedar, etc.) or approved treated wood. This includes posts, beams, joists, decking and railings. Any composite or plastic decking materials must be approved by the building department prior to installation.

Stairs

Minimum width is 36 inches. Maximum rise is 7-3/4 inches, minimum rise is 4 inches. Minimum run is 10 inches. Largest tread width or riser height shall not exceed the smallest by more than 3/8 inch. The tread run is measured from the front of the tread to the front (vertical plain) of the tread above it. Less than 4 inch opening is required at risers greater than 30 inches above grade, and shall extend from the top to the bottom of the stairs. If you have any questions, please call the building department at (763)367-7856.

Illumination

All exterior stairways shall be illuminated. Illumination shall be controlled from inside the dwelling or automatically activated.

Handrails

The top shall be placed not less than 34 inches or more than 38 inches above the nosing of the treads. Stairways having four or more risers shall have at least one handrail with handrail ends returned or terminated into the posts. Circular hand grips shall be between 1-1/4 inches to 2 inches in cross-sectional dimension or the shape shall provide an equivalent gripping surface.


Joist span

Based on No. 2 or better wood grades.
(Design Load = 40#LL + 10#DL, Deflection = L/360)

	Ponderosa pine			Southern pine			Western cedar		
	12"OC	16"OC	24"OC	12"OC	16"OC	24"OC	12"OC	16"OC	24"OC
2x6	9-2	8-4	7-0	10-9	9-9	8-6	9-2	8-4	7-3
2x8	12-1	10-10	8-10	14-2	12-10	11-0	12-1	11-0	9-2
2x10	15-4	13-3	10-10	18-0	16-1	13-5	15-5	13-9	11-3
2x12	17-9	15-5	12-7	21-9	19-0	15-4	18-5	16-0	13-0

Sample calculations for using joist span, beam size and footing size tables

Case I solution:

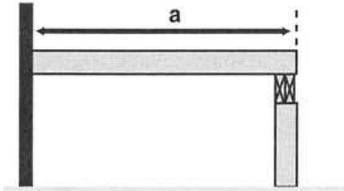


Refer to tables for joist, beam and footing size requirements.

Example: a = 12 feet; Post spacing = 8 feet

Use the **joist span** table to find the acceptable joist sizes for a 12 foot span, 2x8s at 12 inches O.C., 2x10s at 16 inches O.C. or 2x12s at 24 inches O.C.

Use the **Beam and footing sizes** table and find the 8 foot post spacing column. With a 12 foot deck span, the beam may be either two 2x8s or two 2x10s, depending on wood used. Depending on the type of soil, the footing diameter at the base must be a minimum of 12 inches, 10 inches or 9 inches for the corner post and 17 inches, 14 inches or 12 inches for all intermediate posts.

Case II solution:

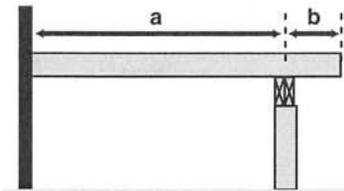


Example: a = 8 feet, b = 2 feet, Post spacing = 10 feet

Refer to the **joist span** table. For an 8 foot joist span, either 2x8s at 24 inches O.C. or 2x6s at 16 inches O.C are acceptable.

For sizing the beam, use a joist length of 12 feet (8 feet + 4 feet) and a post spacing of 10 feet. The **beam and footing sizes** table indicates that the beam may be either two 2x10s or two 2x12s, depending on wood used. Depending on the type of soil, the footing diameter at the base must be a minimum of 15 inches, 12 inches or 11 inches for the corner post and 20 inches, 17 inches or 15 inches for all intermediate posts. Note that because of the 2 foot cantilever all footing sizes were increased by 1 inches as required by footnote 2 at the end of the table.

Case III solution:

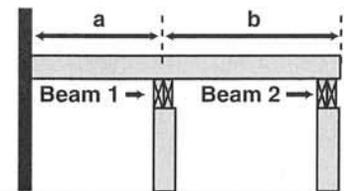

Use "a" or "b", whichever is greater, to determine joist size. Use "a" + "b" to determine the size of Beam 1 and the post footing size for the posts supporting Beam 1. Use joist length "b" to determine both the size of Beam 2 and the post footing size for the posts supporting Beam 2.

Example: a = 6 feet, b = 7 feet, Post spacing = 9 feet

Joist size is determined by using the longest span joist (7 feet). The **joist span** table indicates that 2x6s at 24" O.C. would be adequate for this span.

For Beam 1 and footings, use a joist length of 13 feet (6 feet + 7 feet) and a post spacing of 9 feet. The **beam and footing sizes** table indicates that the beam may be two 2x10s or two 2x12s, depending on the wood used. Depending on the type of soil, the footing diameters for Beam 1 posts shall be 13 inches, 11 inches or 9 inches for the corner (outside) post and 19 inches, 15 inches or 13 inches for all intermediate posts. For Beam 2 and footings use a joist length of 7 feet and post spacing of 9 feet. The beam may be two 2x8s or two 2x10s, depending on wood used. Depending on the type of soil, the footing diameters for Beam 2 shall be 10 inches, 8 inches or 7 inches for the corner posts, and 14 inches, 11 inches or 10 inches for all intermediate posts.

Beam and footing sizes

Based on No. 2 or better Ponderosa Pine and Southern Pine
(Treated for weather and/or ground exposure)


		Post spacing											
		4'	5'	6'	7'	8'	9'	10'	11'	12'	13'	14'	
Joist Length	6'	Southern Pine Beam	1-2x6	1-2x6	1-2x6	2-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10
		Ponderosa Pine Beam	1-2x6	1-2x6	1-2x8	2-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10
		Corner Footing	6 5 4	7 6 5	7 6 5	8 7 6	9 7 6	9 7 6	10 8 7	10 8 7	10 9 7	11 9 8	11 9 8
	Intermediate Footing	9 8 7	10 8 7	10 9 7	11 9 8	12 10 9	13 10 9	14 11 10	14 12 10	15 12 10	15 13 11	16 13 11	
	7'	Southern Pine Beam	1-2x6	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	2-2x12
		Ponderosa Pine Beam	1-2x6	1-2x6	1-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	2-2x12	3-2x10	3-2x10
		Corner Footing	7 5 5	7 6 5	8 7 6	9 7 6	9 8 7	10 8 7	10 8 7	11 9 8	11 9 8	12 10 9	12 10 9
	Intermediate Footing	9 8 7	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	15 13 11	16 13 11	17 14 12	17 14 12	17 14 12
	8'	Southern Pine Beam	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	2-2x12	2-2x12
		Ponderosa Pine Beam	1-2x6	2-2x6	2-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12
		Corner Footing	7 6 5	8 6 6	9 7 6	9 8 7	10 8 7	10 8 7	11 9 8	11 9 8	12 10 9	13 10 9	13 11 9
	Intermediate Footing	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	16 13 11	16 13 12	17 14 12	18 15 13	18 15 13	18 15 13
9'	Southern Pine Beam	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10	
	Ponderosa Pine Beam	1-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	3-2x10	3-2x10	3-2x12	3-2x12	
	Corner Footing	7 6 5	8 7 6	9 7 6	10 8 7	10 9 7	11 9 8	12 10 8	12 10 8	13 10 9	13 11 9	14 11 10	
Intermediate Footing	10 9 7	12 10 8	13 10 9	14 11 10	15 12 10	16 13 11	17 14 12	17 14 12	18 15 13	19 15 13	20 16 14	20 16 14	
10'	Southern Pine Beam	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x10	
	Ponderosa Pine Beam	1-2x6	1-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	
	Corner Footing	8 6 6	9 7 6	10 8 7	10 8 7	11 9 8	12 10 8	12 10 8	13 11 9	14 11 10	14 12 10	15 12 10	
Intermediate Footing	11 9 8	12 10 9	14 11 10	15 12 10	16 13 11	17 14 12	17 14 12	18 15 13	19 16 14	20 16 14	21 17 15	21 17 15	
11'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	
	Ponderosa Pine Beam	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	
	Corner Footing	8 7 6	9 7 6	10 8 7	11 9 8	12 9 8	12 10 9	13 11 9	14 11 10	14 12 10	15 12 10	15 13 11	
Intermediate Footing	12 9 8	13 11 9	14 12 10	15 12 10	16 13 11	17 14 12	17 14 12	18 15 13	19 16 14	20 16 14	21 17 15	21 17 15	
12'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x10	3-2x12	
	Ponderosa Pine Beam	2-2x6	2-2x6	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	Eng Bm	Eng Bm	
	Corner Footing	9 7 6	10 8 7	10 9 7	11 9 8	12 10 9	13 10 9	14 11 10	14 12 10	15 13 11	15 13 11	16 13 11	
Intermediate Footing	12 10 9	14 11 10	15 12 10	16 13 11	17 14 12	18 15 13	19 16 14	20 16 14	21 17 15	22 18 15	23 18 16	23 18 16	
13'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	
	Ponderosa Pine Beam	2-2x6	2-2x6	2-2x8	2-2x10	2-2x12	2-2x12	2-2x12	3-2x10	3-2x12	Eng Bm	Eng Bm	
	Corner Footing	9 7 6	10 8 7	11 9 8	12 10 8	13 10 9	13 11 9	14 12 10	15 12 10	15 13 11	16 13 11	17 14 12	
Intermediate Footing	13 10 9	14 12 10	15 13 11	17 14 12	18 15 13	19 15 13	20 16 14	21 17 15	22 18 15	23 19 16	24 19 17	24 19 17	
14'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	3-2x12	
	Ponderosa Pine Beam	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	Eng Bm	Eng Bm	
	Corner Footing	9 8 7	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	15 13 11	16 13 11	17 14 12	17 14 12	
Intermediate Footing	13 11 9	15 12 10	16 13 11	17 14 12	18 15 13	20 16 14	21 17 15	22 18 15	23 18 16	24 19 17	24 20 17	24 20 17	
15'	Southern Pine Beam	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	
	Ponderosa Pine Beam	2-2x6	2-2x8	2-2x8	2-2x10	3-2x10	3-2x10	3-2x12	3-2x12	Eng Bm	Eng Bm	Eng Bm	
	Corner Footing	10 8 7	11 9 8	12 10 8	13 10 9	14 11 10	14 12 10	15 12 11	16 13 11	17 14 12	17 14 12	18 15 13	
Intermediate Footing	14 11 10	15 12 11	17 14 12	18 15 13	19 16 14	20 17 14	21 17 15	22 18 16	23 19 17	24 20 17	25 21 18	25 21 18	
16'	Southern Pine Beam	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	
	Ponderosa Pine Beam	2-2x6	2-2x8	2-2x10	2-2x10	3-2x10	3-2x10	3-2x12	3-2x12	Eng Bm	Eng Bm	Eng Bm	
	Corner Footing	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	16 13 11	16 13 12	17 14 12	18 15 13	18 15 13	
Intermediate Footing	14 11 10	16 13 11	17 14 12	18 15 13	20 16 14	21 17 15	22 18 16	23 19 16	24 20 17	25 21 18	26 21 18	26 21 18	


Notes:

- Joist length is total length of joist, **including** any cantilevers.
- When joist extends (cantilevers) beyond support beam by 18 inches or more, add 1 inches to footing dimensions shown.
- Requirements for future 3-season porches or screen porches:
 - Increase corner footing size shown by 90%.
 - Increase center footing size shown by 55%.
 - Locate all footings at extremities of deck (no cantilevers).

d. Beam sizes indicated need not be altered.

- All footing sizes above are base diameters (in inches) and are listed for THREE SOIL TYPES:

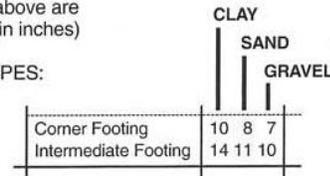

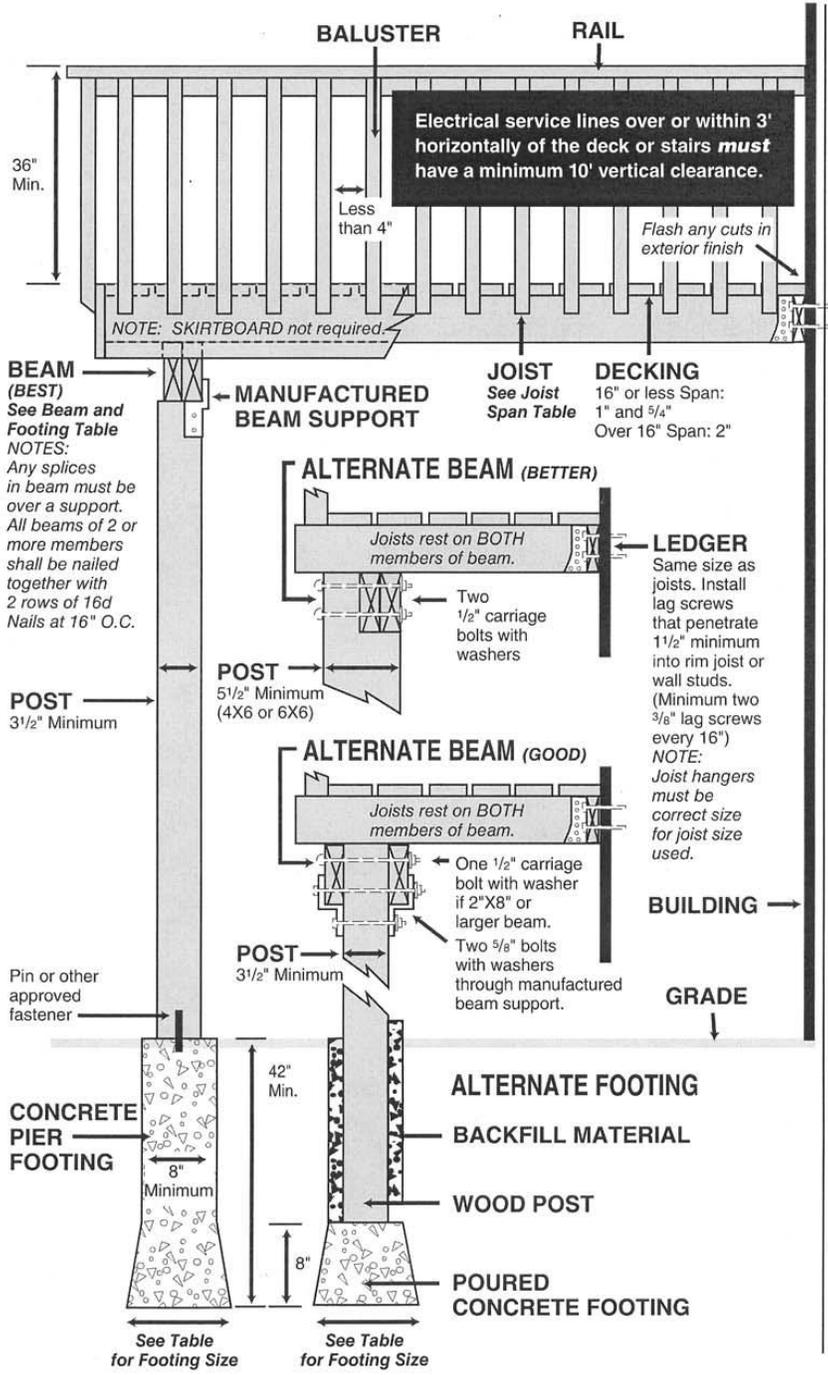

Residential Stairs and Guards Information Sheet

Width

Stairways shall not be less than 36 inches wide. The handrail may enter a maximum of 4-1/2 inches into this dimension. If placing two handrails on a stairway, maintain a minimum of 27 inches.

Dimensional tolerances

The largest tread depth or riser height within any stairway shall not exceed the smallest by more than 3/8 inch.

Risers

Open risers are permitted, provided that the opening between treads does not exceed 4 inches. This does not apply if less than 30 inches above floor or grade.

Headroom

Every stairway shall have a headroom clearance of not less than 6 feet 8 inches. The minimum headroom in all parts of the stairway may not be less than 6 feet 8 inches. This is measured vertically from the sloped plane adjoining the tread nosings or from the floor surface of the landings.

Handrails

Required at four or more risers.

The top shall be placed not less than 34 inches, nor more than 38 inches, above the nosing of the treads. Ends shall be returned or terminated in newel posts or safety terminals.

All required handrails shall be continuous for the full length of the stairs from a point directly above the top riser of the flight to a point directly above the lowest riser of the flight.

Exceptions:


1. Handrails may be interrupted by a newel post at a turn
2. A volute, turnout or newel post is allowed over the lowest tread.

The outside diameter of a circular handrail may be no less than 1-1/4 inches and no greater than 2 inches. A non circular must have a perimeter dimension of at least 4 inches and no greater than 6-1/4 inches. The maximum cross section is 2-1/4 inches. See page 2.


Illumination

All interior and exterior stairways must be illuminated.

Stairway lighting

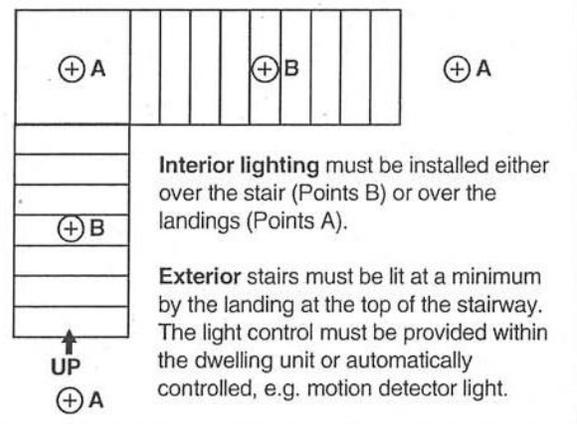


Guard opening limitations

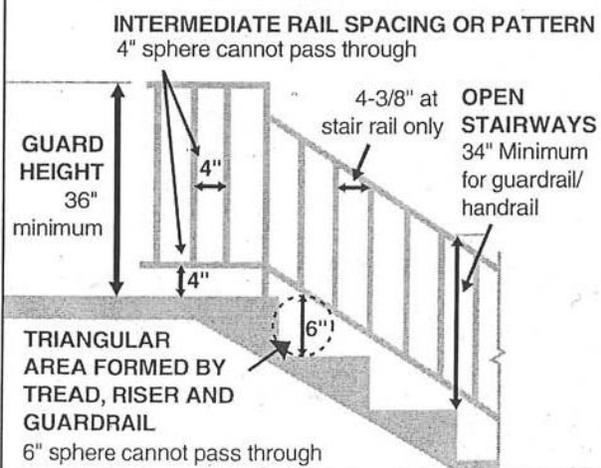

Occupant load less than 10 (Private stairway)

If stairway has closed risers and stair tread is less than 11 inches, a nosing of 3/4 inch depth by no greater than 1-1/4 inch is required.

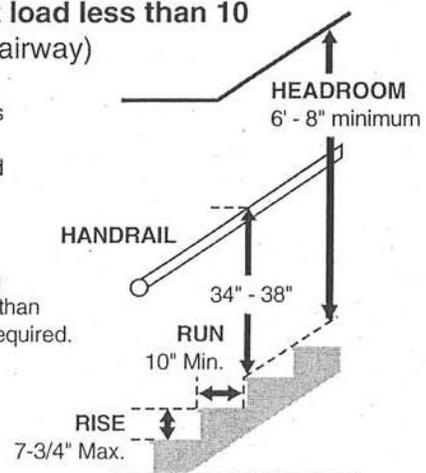

NOTE: REQUIRED HANDRAILS ARE NOT SHOWN

